

ALT-ST0035


filling loop with
pressure gauge



WRAS
APPROVED
PRODUCT

altecnic

ALT-ST0035 filling loop with pressure gauge

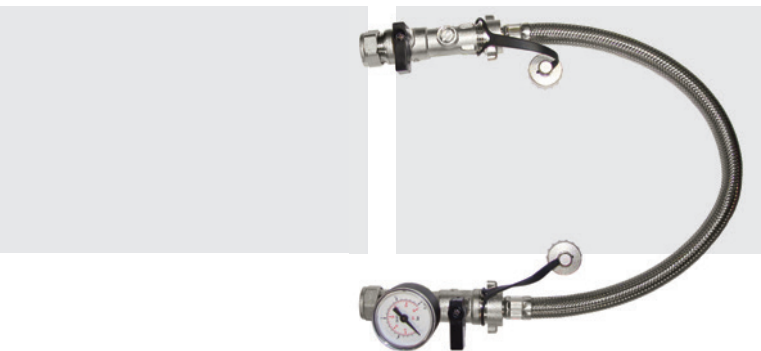

Application

The Altecnic ALT-ST0035 filling loop is used to fill and pressurise domestic central heating systems or in apartment blocks to fill and pressurise the secondary heating systems of Heat Interface Units (HIUs).

The filling loop MUST be installed in accordance with requirements of the Water Regulations Guide -1999, Schedule 2, Section 8, Paragraphs G24.1 and G24.2.

The components of the ALT-ST0035 filling loop meet the requirements of paragraphs G24.1 and G24.2 by consisting of;

- An approved backflow prevention device - a double check valve.
- A temporary connecting pipe - a removable flexible hose.
- A service valve - isolating ball valves.
- A 4 bar pressure gauge

A double check valve is suitable to provide protection against a fluid category 3 risk in the case of a house or similar dwellings.

After the system has been filled and pressurised the service valves must be closed and the flexible hose disconnected and stored in a convenient and suitable place until it is required again.

Design

The Altecnic ALT-ST0035 filling loop consists of a double check valve, a flexible hose with union connectors, sealing washers and a ball isolating valve with 4 bar pressure gauge.

The pressure gauge measures the pressure in the heating system and is especially useful when installed away from the boiler or when the boiler or HIU does not have an integral pressure gauge. Once the system is full and vented the flexible hose must still be removed as per the regulations.

The double check valve and ball valve are manufactured in DZR material with a chrome plated finish for an aesthetic appearance.

The outer layer of the flexible hose is manufactured from braided stainless steel for strength and flexibility.

The inlet connection to double check valve and outlet connection from the ball valve is a 15mm compression joints to complying with BS EN 1252-2 for use with R250 (half hard) copper tube.

E & O.E

Altecnic Ltd Mustang Drive, Stafford, Staffordshire ST16 1GW


T: +44 (0)1785 218200 E: sales@altecnic.co.uk

Registered in England No: 2095101

altecnic.co.uk

AL 198 07-08-14

Dimensions

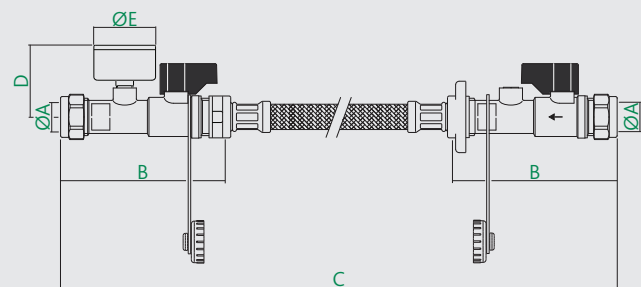

Product Code	ØA	B	C	D	E	kg
CA-300001	15	100	660	52	32	


Construction Details

Component	Material	Grade
Ball valve	DZR	
Double check valve	DZR	
Pressure gauge		
Flexible hose	Stainless Steel	AISI 304
Compression nut	Brass	
Olive	Brass	

Technical Data

Max. inlet pressure:	10 bar
Min. inlet pressure:	0.1 bar
Pressure reducing valve set pressure:	1.5 bar
Max. continuous temperature:	85°C
Double check valve conforms to:	BS EN 13959
WRAS approved product	

Typical Installation

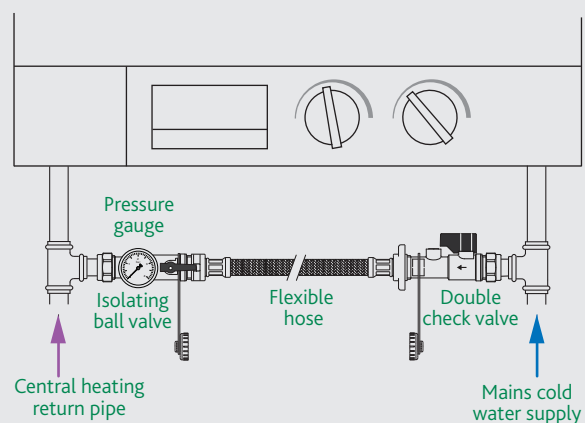

altecnic